

## European Technical Assessment

ETA 15/0776  
of 21/12/15

<b>Technical Assessment Body issuing the ETA and designated according to Article 29 of the Regulation (EU) No 305/2011:</b>	
<b>Trade name of the construction product</b>	<b>K-FLEX - K-Fire Sealant A</b>
<b>Product family to which the construction product belongs</b>	Fire Stopping and Sealing Product Penetration Seals
<b>Manufacturer</b>	<b>L'ISOLANTE K-FLEX UK Ltd</b> Unit 9 Coalville Business Park Jackson Street Coalville Leicestershire LE67 3NR
<b>Manufacturing plant(s)</b>	E/130
<b>This European Technical Assessment contains</b>	15 pages including 3 Annex(es) which form an integral part of this assessment.
	Annex(es) A - C Contain(s) confidential information and is/are not included in the European Technical Assessment when that assessment is publicly available.
<b>This European Technical Assessment is issued in accordance with regulation (EU) No 305/2011, on the basis of</b>	ETAG 026, edition 2011, used as European Assessment Document (EAD)

## General Comments

1. This European Technical Assessment is issued by Warrington Certification Limited on the basis of ETAG 026 Fire Protective Products Part 1: General June 2013, and Part 2: Fire Stopping and Fire Sealing Products Aug 2011, Used as European Assessment Document.
2. This European Technical Assessment is not to be transferred to manufacturers or agents of manufacturers other than those indicated on page 1, or manufacturing plants other than those indicated on page 1.



# 1 SPECIFIC CONDITIONS OF THE EUROPEAN TECHNICAL ASSESSMENT

## 1 Technical Description of the Product

(Detailed information and data are given in Annexes)

- 1) K-Fire Sealant A is an acrylic based material, used to reinstate the fire resistance performance of wall and floor constructions where they have been provided with apertures for the penetrations of multiple services.
- 2) K-Fire Sealant A has slight intumescent properties that cause it to swell on heating.
- 3) Certain seals require the use of THERMAL DEFENSE WRAP is used to insulate the service. The THERMAL DEFENSE WRAP is a 6mm thick foil faced ceramic based insulation material and is utilised externally to the K-Fire Sealant A. See Annex C.
- 4) Certain seals require backfilling with mineral fiber 70mm thick, with a density of 80Kg/m<sup>3</sup>. See Annex C.
- 5) The K-Fire Sealant A is supplied in liquid form contained within 310 ml & 380ml cartridges, 600ml foils or in 5, 10, 20 or 25kg tubs. The sealant is gunned or trowelled into the aperture in or between the separating element/elements to a specified depth utilising various backing materials.

Internal use- ETAG 026-3 (used as European Assessment Document EAD) Type Z<sub>1</sub>.

## 2 Specification Of The Intended Use In Accordance With The Relevant EAD

### 2.1 Intended Use

The intended use of K-Fire Sealant A is to reinstate the fire resistance performance of rigid and flexible wall constructions where they are penetrated by various cables and metallic pipes

- 1) The specific elements of construction that the system K-Fire Sealant A may be used to provide a penetration seal in, are as follows:

Rigid walls: The wall must have a minimum thickness of 150 mm and comprise concrete, aerated concrete or masonry, with a minimum density of 650 kg/m<sup>3</sup>.

Flexible walls The wall must have a minimum thickness of 120 mm and comprise timber or steel studs lined on both faces with minimum 2 layers of 12.5 mm thick, 'Type F' Gypsum boards according to EN 520. In timber stud walls, no part of the penetration shall be closer than 100 mm to a stud, the cavity must be closed between the penetration seal and the stud and minimum 100 mm of insulation of class A1 or A2 according to EN 13501-1, is provided within the cavity between the penetration seal and the stud.

The supporting construction must be classified in accordance with EN 13501-2 for the required fire resistance period.

- 2) The K-Fire Sealant A may be used to provide a penetration seal with pipes and cables (for details see Annex C).



- 3) The total amount of cross sections of services (including insulation) should not exceed 60% of the penetration area.
- 4) The system K-Fire Sealant A may be used to seal apertures in the separating element up to 496mm wide by 100mm high dependant on the configuration. The minimum permitted separation between adjacent seals/apertures is 200mm.
- 5) Pipes must be installed singular, cables require no minimum separation.
- 6) Services in floors shall be supported at maximum 150mm from the face of the separating element.
- 7) The provisions made in this European Technical Assessment are based on an assumed working life of the K-Fire Sealant A of 10 years, provided that the conditions laid down in sections 4.2/5.1/5.2 for the packaging/transport/ storage/installation/use/repair are met. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

## **2.2 Use Category**

Type Z<sub>1</sub>: Intended for use in internal conditions with humidity equal to or higher than 85% RH excluding temperatures below 0°C, without exposure to rain or UV.



### 3 Performance Of The Product And References To The Methods Used For Its Assessment

The assessment of fitness for use has been made in accordance with EOTA ETAG 026 Part 2: 2011-08-08 (used as European Assessment Document, EAD)

ETAG Clause No.	ETA Clause No.	Characteristic	Assessment of characteristic
		Mechanical resistance and stability	Not relevant
		<b>Safety in case of fire</b>	<b>See Clause 2.1</b>
2.4.1	3.1	Reaction to fire	<b>Class F according to EN 13501-1</b>
2.4.2	3.2	Resistance to fire	<b>See clause 2.2 &amp; Annex C</b>
		<b>Hygiene, Health and the Environment</b>	
2.4.3	3.3	Air permeability	<b>See clause 2.3</b>
2.4.4	3.4	Water permeability	No performance determined
2.4.5	3.5	Dangerous substances	<b>See clause 2.5</b>
		<b>Safety in use</b>	
2.4.6	3.6	Mechanical resistance and stability	No performance determined
2.4.7	3.7	Resistance to impact/movement	No performance determined
2.4.8	3.8	Adhesion	No performance determined
		Protection against noise	No performance determined
2.4.9	3.9	Airborne sound insulation	<b>R<sub>w</sub> (C;C<sub>tr</sub>)= 38(-2;-7)</b>
		<b>Energy, Economy and Heat Retention</b>	
2.4.10	3.10	Thermal properties	No performance determined
2.4.11	3.11	Water vapour permeability	No performance determined
		General aspects relating to fitness for use	
2.4.12	3.12	Durability and serviceability	<b>Z<sub>1</sub></b>

#### 3.1 Reaction to fire

System K-Fire Sealant A is classified 'F' in accordance with EN 13501-1.

#### 3.2 Resistance to fire

System K-Fire Sealant A has been tested in accordance with BS EN 1366-3: 2009 based upon the test results and the field of direct application specified within EN 1366-3: 2009, the system K-Fire Sealant A has been classified in accordance with EN 13501-2, as given in Annex C:



The seals may only be penetrated by the services described in Annex C; other parts or support constructions must not penetrate the seal.

The service support construction must be fixed to the building element containing the penetration seal or a suitable adjacent building element, in such a manner that in the case of fire, no additional load is imposed on the seal. Furthermore it is assumed that the unexposed face support is maintained for the required period of fire resistance.

Certain pipe configurations should be insulated with minimum 300mm long, 6mm thick Thermal Defence Wrap. See Annex C

Pipes must be perpendicular to the seal surface.

It is assumed that compressed air systems are switched off by other means in the case of fire.

The function of the pipe seal in case of pneumatic dispatch systems, pressurised air systems etc. is guaranteed only when the systems are shut off in case of fire.

The assessment does not cover the avoidance of destruction of the seal or of the abutting building element(s) by forces caused by temperature changes in case of fire. This has to be considered when designing the piping system.

The approval does not address any risks associated with leakage of dangerous liquids or gases caused by failure of the pipe(s) in case of fire.

The durability assessment does not take account of the possible effect of substances permeating through the pipe on the penetration seal.

### 3.3 Air permeability

System K-Fire Sealant A has been tested in accordance with BS EN 1314-1 to provide the following results:

Product tested				
Pressure (Pa)	Results under positive chamber pressure		Results under negative chamber pressure	
	Leakage (m <sup>3</sup> /h)	Leakage (m <sup>3</sup> /m <sup>2</sup> /h)	Leakage (m <sup>3</sup> /h)	Leakage (m <sup>3</sup> /m <sup>2</sup> /h)
50	0.0	0.0	0.0	0.0
100	0.0	0.0	0.0	0.0
150	0.0	0.0	0.1	2.8
200	0.0	0.0	0.1	2.8
250	0.0	0.0	0.1	2.8
300	0.0	0.0	0.0	0.0
450	0.1	2.8	0.1	2.8
600	0.1	2.8	0.1	2.8

### 3.4 Water permeability

No performance determined



### **3.5 Dangerous substances**

The applicant has presented a declaration that K-Fire Sealant A does not contain any substance of high concern with regards to REACH Regulations and are compliant with the requirements reference to <http://ec.europa.eu/enterprise/construction/cpd-ds/index.cfm>

Confirmation has further been declared that all dangerous chemical substances  $\geq 1.0$  % w/w as well as all toxic, carcinogenic, toxic for reproduction and mutagenic chemical substances  $\geq 0.1$  % w/w (Status: 29. adaption – 2004/73/EG – of the EU directive 67/548/EEC - classification, packaging and labeling of dangerous substances) are stated in the K-Fire Sealant A safety data sheets (according to 91/155/EEC including amendments) and have been considered for the classification of the products according to the directive 1999/45/EG (classification of preparations, including amendments).

All dangerous chemical substances are below the classification limits of 67/548/EEC.

In addition to the specific clauses relating to dangerous substances contained in this European technical approval, there may be other requirements applicable to the products falling within its scope (e.g. transposed European legislation and national laws, regulations and administrative provisions). In order to meet the provisions of the Construction Products Regulation, these requirements need also to be complied with, when and where they apply.

### **3.6 Mechanical resistance and stability**

No performance determined.

### **3.7 Resistance to impact/movement**

No performance determined.

### **3.8 Adhesion**

Not relevant.

### **3.9 Airborne sound insulation**

The results of the test provided the following single number rating:

**R<sub>w</sub> (C;Ctr)= 38(-2;-7)**

### **3.10 Thermal Properties**

No performance determined.

### **3.11 Water vapour permeability**

No performance determined.



### 3.12 Durability and serviceability

K-Fire Sealant A has been tested in accordance with EOTA Technical Report - TR024 – Edition November 2006, for the type Z<sub>1</sub> use category specified in ETAG 026-2 (used as European Assessment Document, EAD), and the results of the tests have demonstrated suitability for penetration seals intended for use in internal conditions with humidity equal to or higher than 85% RH excluding temperatures below 0°C, without exposure to rain or UV.

## 4 Assessment And Verification Of Constancy Of Performance (Hereinafter AVCP) System Applied, With References To Its Legal base

According to the decision 1999/454/EC of the European Commission the system of assessment and verification of constancy of performance (see Annex V to the Regulation (EU) No 305/2011) given in the following table apply:

Products	Intended uses	Level or Class	System
Fire stopping and fire sealing products	For fire compartmentation and / or fire protection or fire performance	Any	System 1





## **5. Technical Details Necessary For The Implementation Of The AVCP System, As Provided For In The Applicable EAD.**

### **Tasks for the Manufacturer**

#### **Factory production control**

The manufacturer shall exercise permanent internal control of production. All the elements, requirements and provisions adopted by the manufacturer shall be documented in a systematic manner in the form of written policies and procedures, including records of results performed. This production control system shall ensure that the product is in conformity with this European technical assessment.

The manufacturer may only use constituent materials stated in the technical documentation of this European technical assessment.

The factory production control shall be in accordance with the Control Plan of 4.10.13 relating to the European technical assessment ETA 15/0776 which is part of the technical documentation of this European technical assessment. The "Control Plan" is laid down in the context of the factory production control system operated by the manufacturer and deposited at Warrington Certification Limited.

The results of factory production control shall be recorded and evaluated in accordance with the provisions of the Control Plan.

#### **Other tasks of manufacturer**

##### Additional information

The manufacturer shall provide a technical data sheet and an installation instruction with the following minimum information:

(a) Technical data sheet:

- Field of application:
  - Building elements for which the penetration seal is suitable, type and properties of the building elements like minimum thickness, density, and - in case of lightweight constructions – the construction requirements.
  - Services for which the penetration seal is suitable, type and properties of the services like material, diameter, thickness etc. in case of pipes including insulation materials; necessary/allowed supports/fixings (e.g. cable trays)
  - Limits in size, minimum thickness etc. of the penetration seal
  - Construction of the penetration seal including the necessary components and additional products (e.g. backfilling material) with clear indication whether they are generic or specific.
- (a) Construction of the penetration seal including the necessary components and additional products (e.g. backfilling material) with clear indication whether they are generic or specific.



(b) Installation instruction:

- Steps to be followed
- Procedure in case of retrofitting.

### **Tasks of approved bodies**

The approved body shall perform the

- initial type-testing of the product,
- initial inspection of factory and of factory production control,
- continuous surveillance, assessment and approval of factory production control,

In accordance with the provisions laid down in the "Control Plan" of 4.10.13 relating to the European Technical Assessment 15/0776.

The approved body shall retain the essential points of its actions referred to above and state the results obtained and conclusions drawn in a written report.

The approved certification body involved by the manufacturer shall issue an EC certificate of conformity of the product stating the conformity with the provisions of this European technical assessment.

In cases where the provisions of the European technical assessment and its "Control Plan" are no longer fulfilled the certification body shall withdraw the certificate of conformity and inform the Warrington Certification Limited without delay.



## Signatories

---



Responsible Officer

C. Abbott\* - Principal Certification Engineer



Approved

A. Kearns\* - Technical Manager

\* For and on behalf of Warrington Certification Limited.



## **Annex A**

### **Reference Documents and LIST OF ABBREVIATIONS**

References to standards mentioned in the ETA:

EN 13501-1	Fire classification of construction products and building elements – Part 1: Classification using test data from reaction to fire tests
EN 13501-2	Fire classification of construction products and building elements – Part 2: Classification using test data from fire resistance tests

Other reference documents:

EOTA TR 024	Characterisation, Aspects of Durability and Factory Production Control for Reactive Materials, Components and Products
ETAG No. 026: Part 2	Guideline For European Technical Approval of Fire Stopping and Fire Sealing Products, Part 2: Penetration Seals(used as European Assessment Document, EAD)



## **Annex B**

### **Description of Product**

#### **K-Fire Sealant A**

A detailed specification of the product is contained in document "Evaluation Report" relating to the European Technical Approval ETA – 15/0776 issued on 21/12/15, of K-Fire Sealant A which is a non-public part of this ETA.




## Annex C

### Resistance to Fire Classification of K-Fire Sealant A

#### C.1.1 Flexible and Rigid wall constructions according to 1.2.1 with wall thickness of minimum 120 mm

#### C.1.2 Penetration seal with K-Fire Sealant A installed flush to both faces of wall

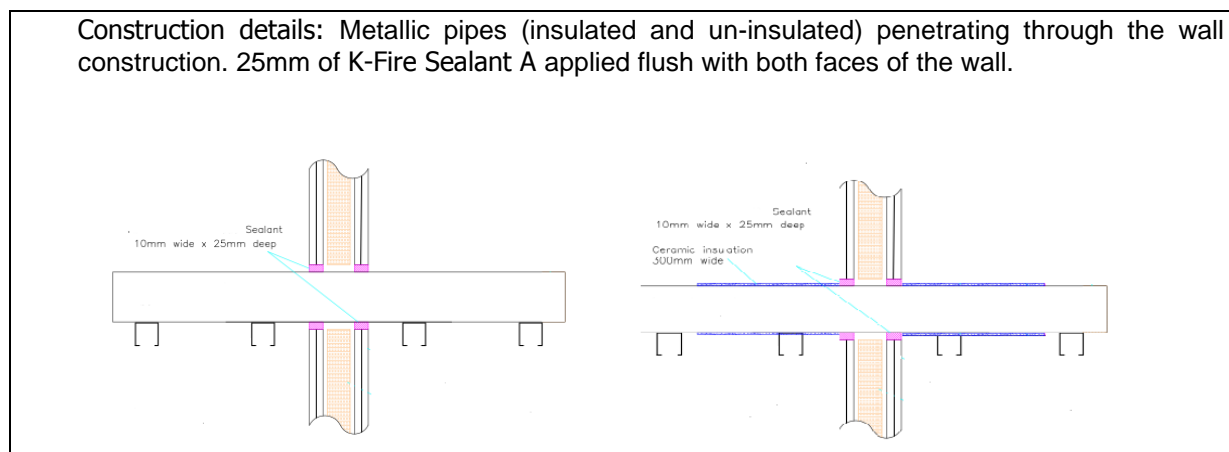

#### C.1.3


<b>K-Fire Sealant A Penetration Seals. Min 120 mm Thick Flexible or Rigid Wall.</b>			
<b>Penetration Specification</b>	<b>K-Fire Sealant A (installed both faces)</b>	<b>Backing Material</b>	<b>Classification</b>
Copper/Steel Pipe 15mm $\varnothing$ , 0.8mm – 7.4mm wall thickness	10mm annulus x 25mm deep	N/A	<b>E120 C/U</b> <b>EI20 C/U</b>
Copper/Steel Pipe 40mm $\varnothing$ , 0.8mm – 14.2mm wall thickness	10mm annulus x 25mm deep	N/A	<b>E120 C/U</b> <b>EI15 C/U</b>
Copper/Steel Pipe 40-159mm $\varnothing$ , 1.8mm – 14.2mm wall thickness	10mm annulus x 25mm deep	N/A	<b>E120 C/U</b>
Copper/Steel Pipe 40mm $\varnothing$ , 0.8mm – 14.2mm wall thickness*	10mm annulus x 25mm deep	N/A	<b>E120 C/U</b> <b>EI90 C/U</b>
Copper/Steel Pipe 40-159mm $\varnothing$ , 1.8mm – 14.2mm wall thickness*	10mm annulus x 25mm deep	N/A	<b>E120 C/U</b> <b>EI20 C/U</b>

\* Thermal defence wrap to the unexposed face 300mm long



## C.2 Flexible and Rigid wall constructions according to 1.2.1 with wall thickness of minimum 120 mm

### C.2.2 Penetration seal with K-Fire Sealant A installed flush to both faces of wall

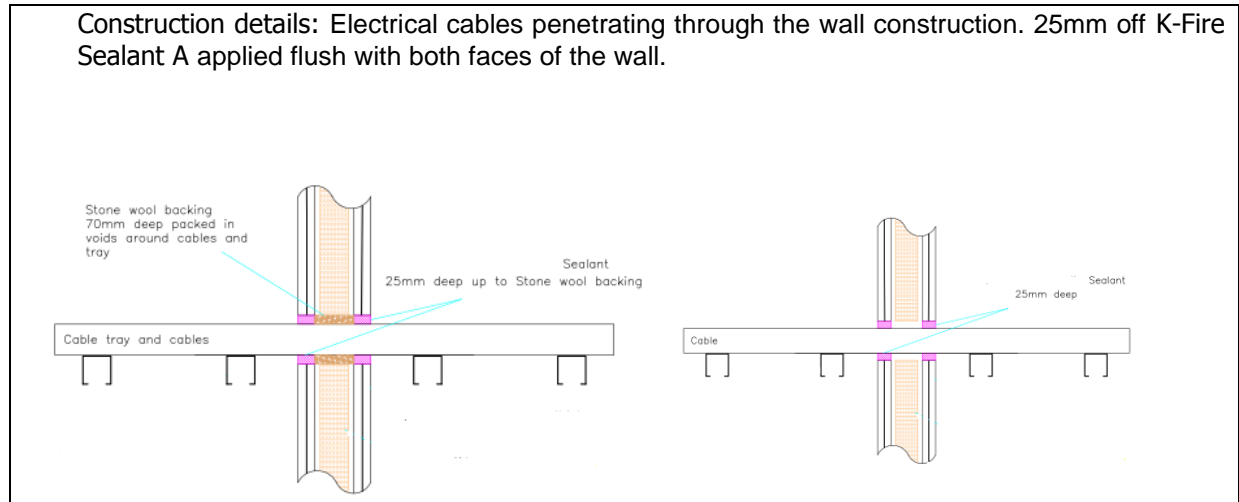

### C.2.3

<b>K-Fire Sealant A Penetration Seals. Min 120 mm Thick Flexible or Rigid Wall.</b>			
<b>Penetration Specification</b>	<b>K-Fire Sealant A (installed both faces)</b>	<b>Backing Material</b>	<b>Classification</b>
Cables up to 21mm	490mm long x 100mm high x 25mm deep	70mm thick, 80Kg/m <sup>3</sup>	<b>E120 EI90</b>
Perforated Cable Tray 450mm x 50mm			
Cables up to 21-50mm	200mm long x 100mm high x 25mm deep	N/A	<b>E90 EI60</b>

